



尤提乐电气有限公司

Utility Electrical Co.,Ltd

SPECIFICATION FOR PRODUCT

Part name: DINRAIL FIXED TERMINAL BLOCK

Part No.: JUT1 – 4/2–2-XX

Customer P/N:

Date: 2008-12-10

Seller Confirmation

Written by	H.C
Checked by	Jammy.ling
Approved by	Eric

Customer Confirmation

Project Audit	
Structure Audit	
Security Certification	
Quality Approval	

Seller: Shanghai Utility Electrical Co., Ltd

Add: 1759# Zhongshan Road ,Shanghai

Tel: 021-61478435 Fax:021-61478103


E-Mail: Marketing@china-utl.com

Customer:	Customer P/N:
Seller: Zhejiang Utility Electrical Co., Ltd	Part No: JUT1-4/2-2-XX


Revision for JUT1-4/2-2-XX

Item No	Edition	Part Revised	Date Revised
1	A	New	2008-12-10
2			
3			
4			
5			


1. TYPE: JUT1-4/2-2-XX

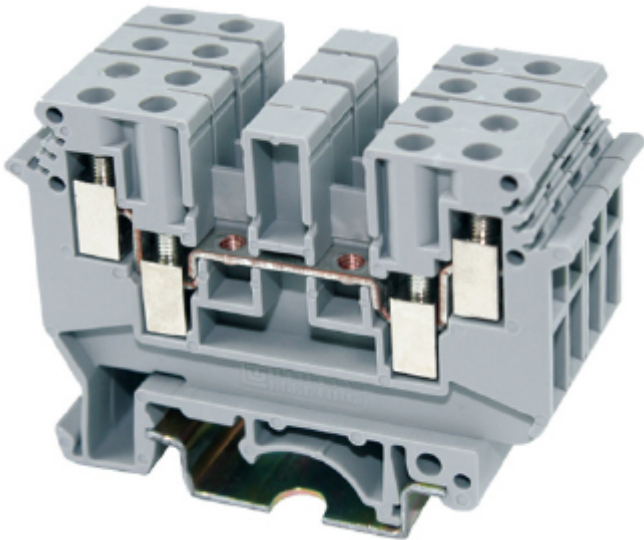

aming system:

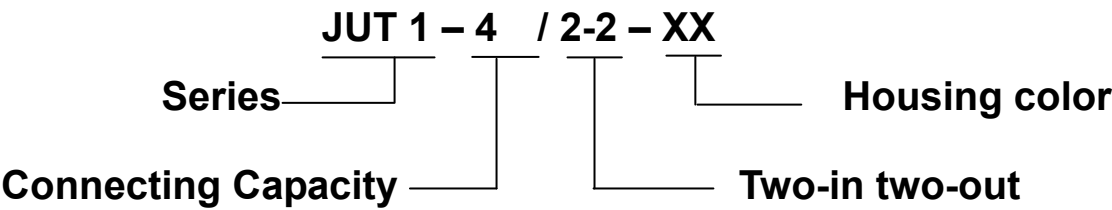

2.DRAWING&SIZES

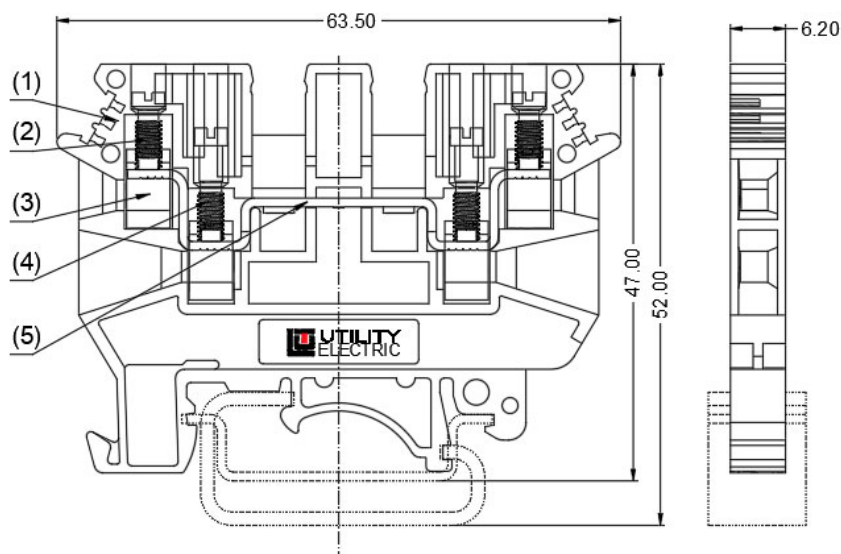

OVERALL SIZES TOLERANCE

>120	±0.80
>30~120	±0.50
>6~30	±0.40
0~6	±0.25

3. BOM TABLE

ITEM.	PART NAME	MATERIAL	SURFACE OF CONTACT	QUANTIT Y(PCS)
(1)	Housing	PA66(UL94 V-0)	N/A	1
(2)	Screw	Brass	Nickel Plated	2
(3)	Block	Brass	Nickel Plated	4
(4)	Screw	Brass	Nickel Plated	2
(5)	conductor	Copper	Tin Plated	1

4. WIRE ENTRANCE: Tow-in tow-out wiring terminal

PITCH: 6.2 mm

WIRE RANGE: 12-24AWG

5. TECHNICAL DATA:

MAX. TORQUE: 0.5 N*m

ELECTRICAL RATING: AC690V, 32A

DIELECTRIC WITHSTAND: AC2500V, 1min

BREAKDOWN VOLTAGE: 4000V(1.2/50us, 5times each plus and minus pole)

INSULATION RESISTANCE: DC500V, More than 500MΩ

Stripping Length: 8mm

6. WORKING CONDITION:

OPERATING TEMPERATURE: -40℃~+105℃

ALTITUDE: Less than 2000m 40Kpa~80KPa

RELATIVE HUMIDITY: 5%~95%

POLLUTION DEGREE: III

7. APPLICABLE STANDARDS

IEC 60998-1

IEC 60998-2-1

IEC 60947-1

IEC 60947-7-1

UL 1059

UL 486E

CSA22.2 158-1987

GB 14048.1

GB 14048.7

8. PROCEDURE

Dinrail mounting and suit to solid and stranded wire connecting.



Solid wire



stranded wire

9. PACKAGE:

Tightly Sealed